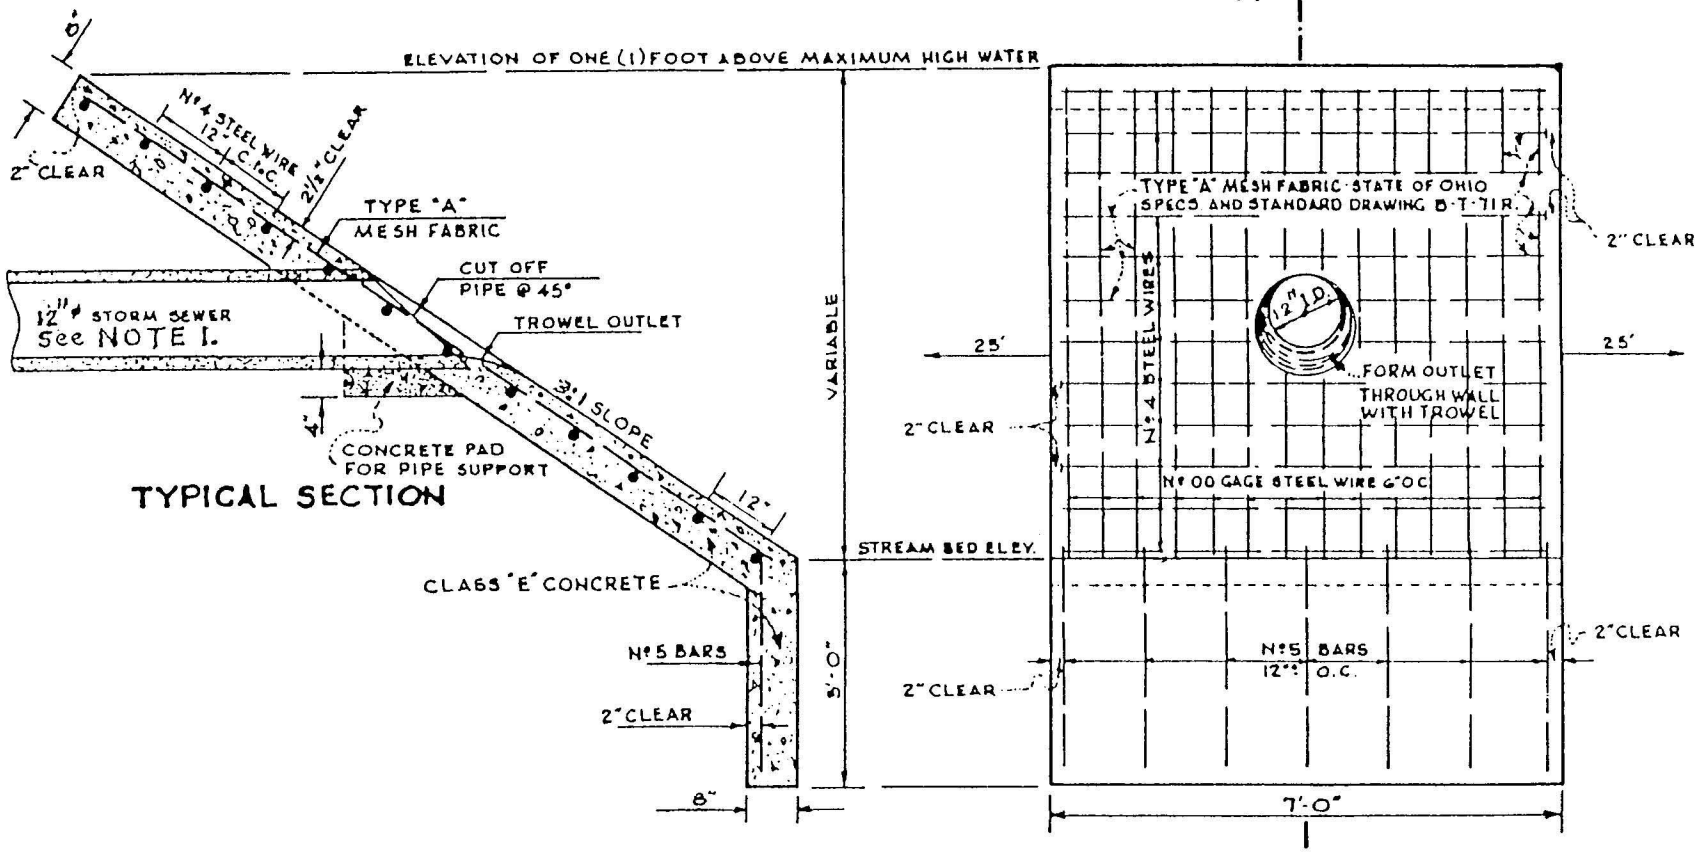

NOTE:

1. INCREASE WIDTH OF WALL SIX (6) INCHES FOR EACH THREE (3) INCH INCREASE IN
2. DIAMETER OF OUTFALL PIPE.
3. ALL MESH FABRIC SHALL BE FURNISHED IN FLAT SHEETS.
4. EDGE TOOL ALL EXPOSED CONCRETE EDGES IN SLOPE WALLS.
5. GRADE BANK OF STREAM FROM THE HEADWALL SLOPE TO A WARPED SURFACE TO MEET THE EXISTING BANK SLOPE IN TWENTY FIVE (25) FEET EACH WAY.

SLOPED HEADWALL

PLATE 4

HW-7